

# NJEX® Odorant Injection System

## Models 6300 and 6302

NJEX 6300 and 6302 odorant injection systems inject precise amounts of liquid odorant into cubic feet or meters, of gas that flows down a pipeline to ensure detectability. Ideal for lower flow applications, these proven systems provide proportional-to-flow odorant injection, onboard metering of the odorant injected, system monitoring and alarm notification. Additionally the system will document and verify the performance of each system component, parameter changes, alarms and injection rates. Available in a single or dual-unit configuration, the systems are capable of accurately injecting up to 6.7 liters/day (1.76 gallons/day).


### Features and Benefits

- Patented, pneumatically-actuated, positive-displacement plunger pump
- 6.7 liters/day (1.76 gallons/day) maximum odorant output
- Versatile, electronic controller for proportional-to-flow or time-based injection
- Real-time system monitoring and alarm notifications
- Remote communication via ModBus or Sentry4 Software
- Intrinsically safe electronics
- Single or Dual Configuration to meet application requirements
- Weatherproof enclosure for protection from the elements.

### Specifications

<b>Maximum odorant output</b>	6.7 liters/day (1.76 gallons/day)
<b>Maximum operating pressure</b>	99.28 bar (1440 psig)
<b>Operating temperature range</b>	17°C to 60°C (0°F to 140°F) <sup>1</sup>
<b>Power supply</b>	
<b>Standard</b>	SPS-12 solar panel
<b>Optional</b>	LPS 120/240 volt, 50/60 Hz AC charger
<b>Battery reserve</b>	Approximately 30 days
<b>Gas flow rate input signal</b>	1-5 VDC, 4-20 mA or pulse

<sup>1</sup>At temperatures below 0°C (32°F) conditioning of the actuation gas supply may be required.

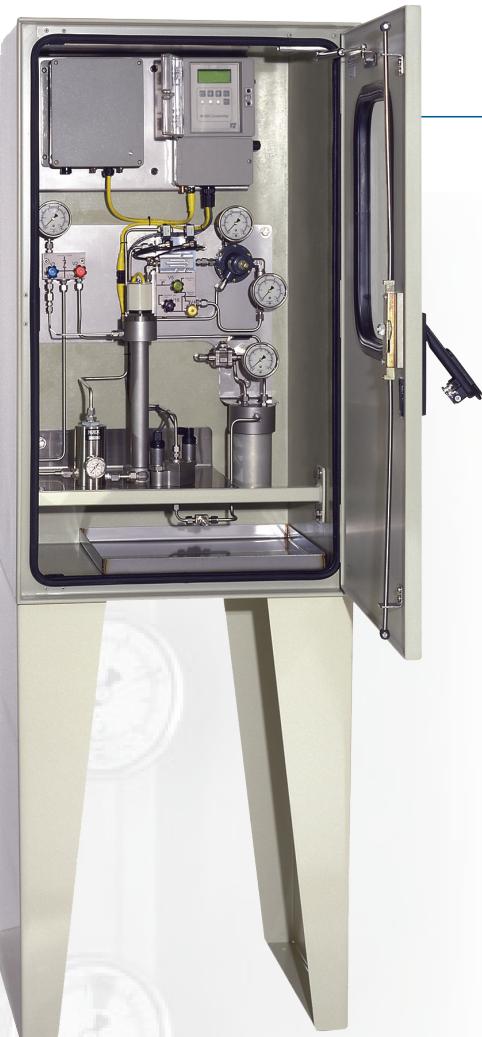

## System Flow Schematic

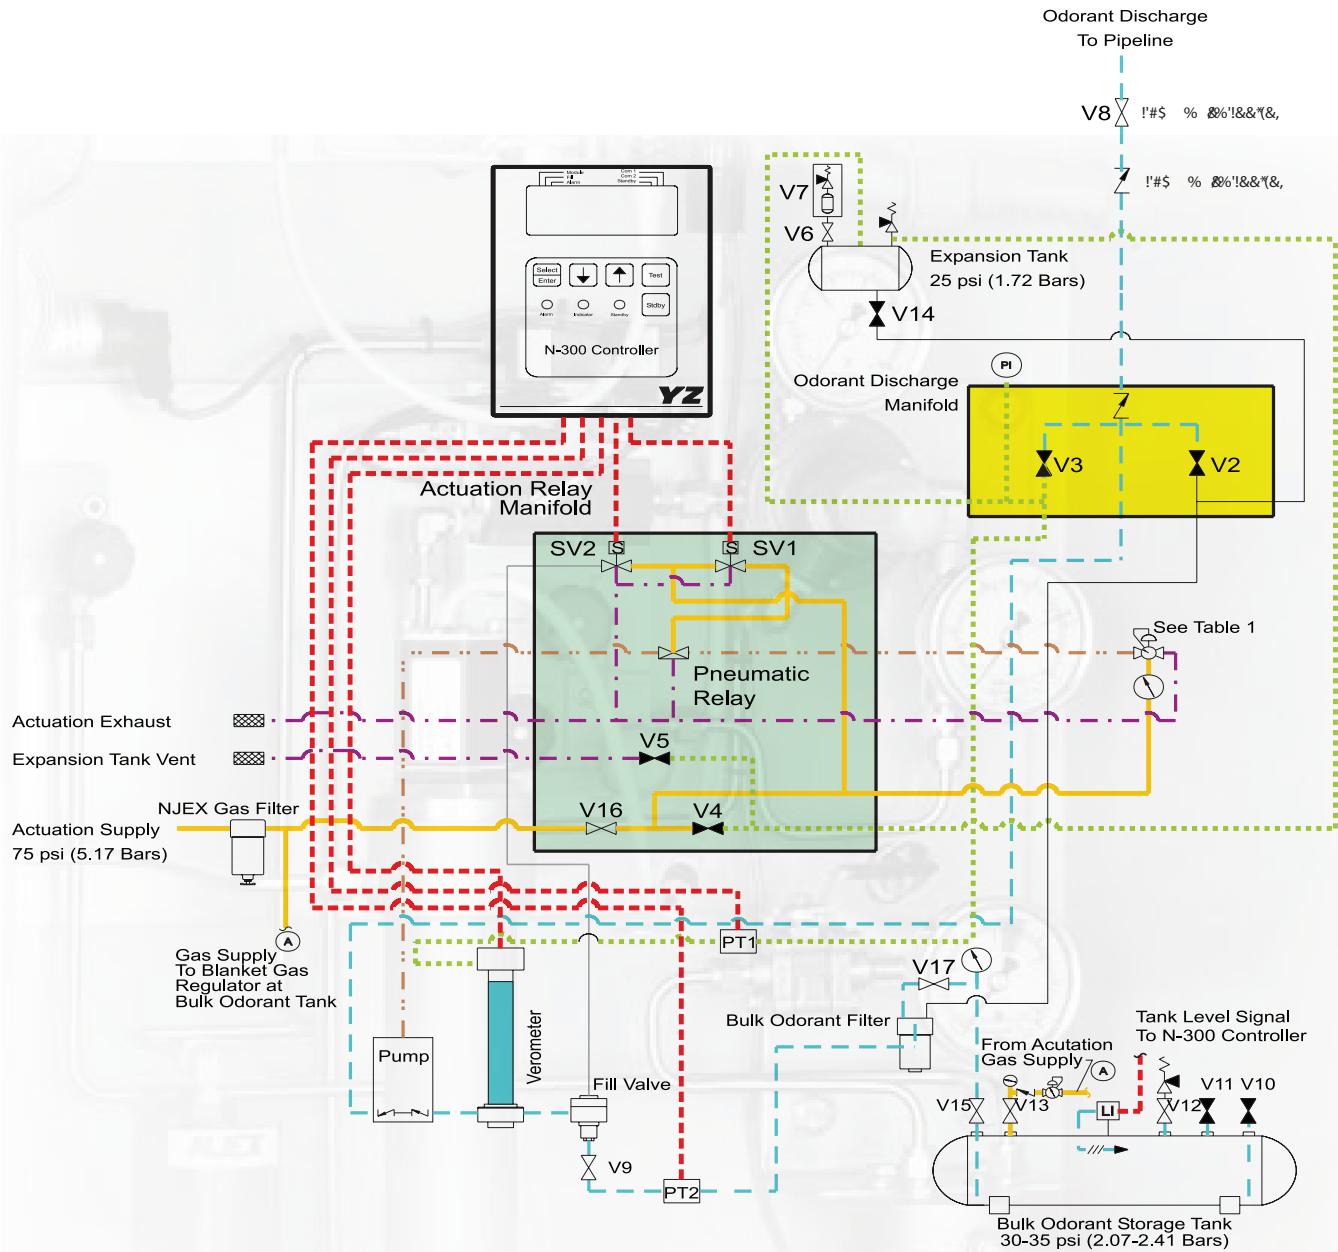


Table 1	
6300	
Pipeline Pressure	Actuation Pressure
100-200 psi (6.89-13.8 Bar)	30 psi (2.07 Bar)
200-500 psi (13.89-34.5 Bar)	40 psi (2.76 Bar)
500-900 psi (34.5-62.1 Bar)	50 psi (3.45 Bar)
900-1400 psi (62.1-96.5 Bar)	60 psi (4.14 Bar)

IMPORTANT: Read And Follow Steps 1-4 BEFORE Proceeding															
1. Place the controller in the "standby" mode.	V2	V3	V4	V5	V6	V8	V9	V10	V11	V12	V13	V14	V15	V16	V17
2. Close all valves marked "x".	x	x	x	x	o	*	x	x	o	o	x	o	o	o	o
3. Open all valves marked "O".	o	x	x	x	x	x	*	x	x	o	o	x	o	o	x
4. Place controller in the proper mode of operation as needed.	o	o	x	x	x	*	x	x	o	o	x	o	o	x	o
■ Close to full pressure to 60 psi (4.14 Bars) then close valve *	o	o	x	x	x	*	x	x	o	o	x	o	o	x	o
* - Adjust as needed															

### LEGEND

- |   |                                    |      |                                    |    |   |     |   |     |                                     |
|---|------------------------------------|------|------------------------------------|----|---|-----|---|-----|-------------------------------------|
| ▀ | Normally Closed Valve              | ---- | Liquid Odorant - Normal Operation  | V2 | Purge Valve (Red Knob)                            | V11 | Odorant Storage Tank Vapor Return Valve           | SV2 | Fill Valve Solenoid Valve           |
| ▀ | Normally Open Valve                | ---- | Purge/Drain Line                   | V3 | Prime Valve (Blue Knob)                           | V12 | Odorant Storage Tank Relief Valve Isolation Valve | PT1 | Expansion Tank Pressure Transmitter |
| ▀ | Pneumatic Relay                    | ---- | Expansion Line                     | V4 | Expansion Tank Pressure Supply Valve (Gold Knob)  | V13 | Odorant Storage Tank Blanket Gas Isolation Valve  | PT2 | Odorant Inlet Pressure Transmitter  |
| ▀ | Intrinsically Safe Electrical Line | ---- | Extrinsically Safe Electrical Line | V5 | Expansion Tank Vent Valve (Green Knob)            | V14 | Expansion Tank Drain Valve                        |     |                                     |
| ▀ | Extrinsically Safe Electrical Line | ---- | Extrinsically Safe Electrical Line | V6 | Expansion Tank Overflow Preventer Isolation Valve | V15 | Odorant Storage Tank Supply Isolation Valve       |     |                                     |
| ▀ | Extrinsically Safe Electrical Line | ---- | Extrinsically Safe Electrical Line | V7 | Expansion Tank Overflow Preventer Isolation Valve | V16 | Gas Supply Isolation Valve (Black Knob)           |     |                                     |
| ▀ | Extrinsically Safe Electrical Line | ---- | Extrinsically Safe Electrical Line | V8 | Odorant Discharge To Pipeline                     | V17 | System Odorant Supply Isolation Valve             |     |                                     |
| ▀ | Extrinsically Safe Electrical Line | ---- | Extrinsically Safe Electrical Line | V9 | Fill Rate Control Valve                           | V10 | Odorant Storage Tank Fill Valve                   | SV1 | Pump Actuation Pilot Solenoid Valve |
| ▀ | Extrinsically Safe Electrical Line | ---- | Extrinsically Safe Electrical Line |    |   |     |   |     |                                     |